


Richter Shut-off and Control Butterfly Valve

Lug-style body: Series NKL
Sandwich-type body: Series NKS
Double-flange body: Series NK

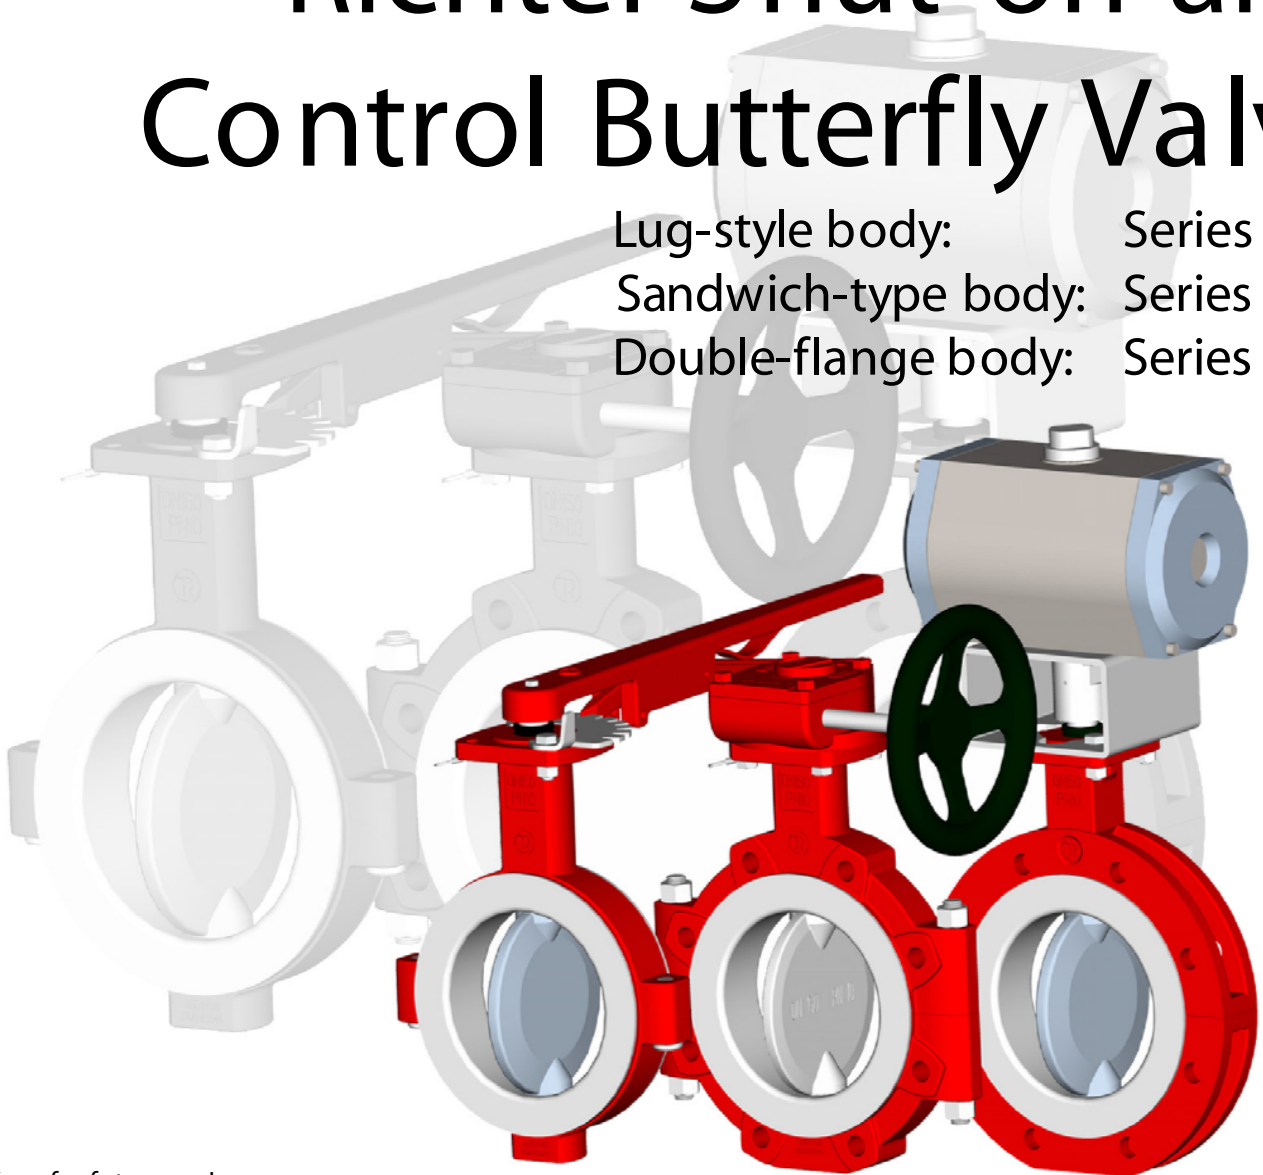

Keep for future use!

This operating manual must be strictly observed before transport, installation, commissioning etc. in order to avoid endangering.

Subject to change without notice.

Reproduction is generally permitted with indication of the source.

© Richter Chemie-Technik GmbH

List of Contents

1	Technical data	3	7	Operation	12
1.1	Type code.....	3	7.1	Initial commissioning	12
1.2	Name plate, CE and body markings	4	7.2	Inadmissible modes of operation and their consequences.....	12
1.3	Tightening torques.....	4	7.3	Shutdown.....	12
1.4	Dimensions.....	6	7.3.1	.. Additional advice for shut-off and control butterfly valve with actuator.....	12
1.5	Flow rate value k_v [m ³ /h].....	6	8	Malfunctions	12
1.6	Weights (ca. kg)	6	9	Maintenance	13
1.7	Pressure-temperature-diagram	7	9.1	Notes for assembly	13
1.8	Breakaway torques.....	7	9.1.1	.. Safety stuffing box:.....	13
1.9	Cavitation coefficient z for 75% duty	7	9.2	Valve actuation	13
2	Notes of safety	7	9.2.1	.. Actuated with lever	13
2.1	Intended use.....	8	9.2.2	.. Actuated by means of worm gear	13
2.2	For the customer / operator.....	8	9.2.3	.. Remotely actuated	14
2.3	Inadmissible modes of operation	8	9.2.4	.. Required breakaway torque.....	14
3	Safety notes for applications in potentially explosive areas based on the Directive 94/9/ EC (Atex 95)	8	9.3	Options	14
3.1	Intended use.....	9	9.3.1	.. Safety stuffing box.....	14
4	Safety note for valves, certified to Clean Air Act (TA-Luft)	9	9.3.2	.. Monitoring connection	14
5	Transport and storage	10	9.3.3	.. Proximity switch.....	14
5.1	Storage.....	10	9.4	Tests	14
5.2	Transport preparations	10	10	Drawings	15
5.3	Return consignments	10	10.1	Legend.....	15
5.4	Transport securing device.....	10	10.2	Safety stuffing box (Option)	15
6	Installation	11	10.3	Sectional drawing NKL	16
6.1	Installation possibilities.....	11	10.4	Sectional drawing NKS	17
6.2	Flange caps and gaskets	11	10.5	Schnittzeichnung NK	18
6.3	Direction of flow and installation position	11	10.6	Connecting dimensions worm gear	19
6.4	Installation	11	10.7	Connecting dimensions actuator	19
6.4.1	.. Additional advice for shut-off and control butterfly valve with actuator.....	11			
6.5	Earthing	11			

Relevant documents

- ◆ Declaration of conformity acc. to the EC Pressure Equipment Directive 97/23/EG
- ◆ Form for General Safety Certificate QM 0912-16-2001_en
- ◆ For NKLP, NKSP or NKP operating manual for actuator

On request :

Installation and inspection regulations for centric shut-off valves of the series NK/NKP, NKL/NKLP, NKS/NKSP, QM No. 0910-08-1005

1 Technical data

Manufacturer:

Richter Chemie-Technik GmbH
 Otto-Schott-Str. 2
 D-47906 Kempen
 Telefon : +49 (0) 2152 146-0
 Fax: +49 (0) 2152 146-190
 E-Mail : richter-info@richter-ct.com
 Internet: <http://www.richter-ct.com>

Designation:

Shut-off and control butterfly valve in 3 body designs:
 lug-style, sandwich-type and double flange.
 Disc/stem unit plastic-lined, stainless steel or Hastelloy

Certified to Clean Air Act (TA-Luft)

Strength and tightness (P10, P11) of the pressure-bearing body tested to DIN EN 12266-1.

Gas-tight (P12) in the seat to DIN EN 12266-1, leak rate A

Flange connecting dimensions:

DIN EN 1092-2, shape B, (ISO 7005-2 type B) PN 10 or ASME B16.5 class 150

Face to face:

DIN EN 558-1, basic series 20 (ISO 5752 series 20) or API 609 table 1 or MSS SP-67 table 3

Weights: See [Section 1.6](#)

Dimensions and individual parts:

See [Section 10](#)

Materials:

Body material: Ductile cast iron EN-JS 1049 to DIN EN 1563 (0.7043 DIN 1693)

Lining material: PTFE/PFA

on request : conductive design

Disc/stem unit: PFA-lined or ..-F
 Stainless steel 1.4408 or ..-S
 Hastelloy C4 ..-H

Temperature range: -60 °C to +200 °C
 (-80 °F to +400 °F)

accord. to operating pressure

See pressure-temperature diagram in [Section 1.7](#).

Operating pressure: from vacuum to 10 bar
 (145 psig)
 accord. to operating pressure

Valve sizes in mm :

with hand lever: DN 50, 80, 100, 150, 200
 2", 3", 4", 6", 8"

with worm gear DN 50, 80, 100, 150, 200, 250, 300, 350, 400
 2", 3", 4", 6", 8", 10", 12", 14", 16"
 NK only up to DN 300

with actuator: DN 50, 80, 100, 150, 200, 250, 300, 350, 400
 2", 3", 4", 6", 8", 10", 12", 14", 16"
 NKP only up to DN 300


Activation: Hand lever, lockable
 Worm gear with handwheel
 Pneumatic or electric
 (connection to ISO 5211)

Options: Safety stuffing box
 Monitoring connection
 Proximity initiator
 Polished disc surfaces

1.1 Type code

Shut-off and control butterfly valve with lug-style body

NKL/F	Disc/stem unit of PFA , with lockable hand lever or worm gear with manual actuation
NKLP/F	Disc/stem unit of PFA , with actuator
NKL/F-S	Disc/stem unit of stainless steel , with lockable hand lever or worm gear with manual actuation
NKLP/F-S	Disc/stem unit of stainless steel , with actuator
NKL/F-H	Disc/stem unit of Hastelloy C4 , with lockable hand lever or worm gear with manual actuation
NKLP/F-H	Disc/stem unit of Hastelloy C4 , with actuator



Shut-off and control butterfly valve with sandwich-type body

- NKS/F Disc/stem unit of **PFA**, with lockable hand lever or worm gear with manual actuation
- NKSP/F Disc/stem unit of **PFA**, with actuator
- NKS/F-S Disc/stem unit of **stainless steel**, with lockable hand lever or worm gear with manual actuation
- NKSP/F-S Disc/stem unit of **stainless steel**, with actuator
- NKS/F-H Disc/stem unit of **Hastelloy C4**, with lockable hand lever or worm gear with manual actuation
- NKSP/F-H Disc/stem unit of **Hastelloy C4**, with actuator



Shut-off and control butterfly valve with double-flange body

- NK/F Disc/stem unit of **PFA**, with lockable hand lever or worm gear with manual actuation
- NKP/F Disc/stem unit of **PFA**, with actuator
- NK/F-S Disc/stem unit of **stainless steel**, with lockable hand lever or worm gear with manual actuation
- NKP/F-S Disc/stem unit of **stainless steel**, with actuator
- NK/F-H Disc/stem unit of **Hastelloy C4**, with lockable hand lever or worm gear with manual actuation
- NKP/F-H Disc/stem unit of **Hastelloy C4**, with actuator




For material designation on the name plate, see **Section 1.2**

1.2 Name plate, CE and body markings

The stainless steel name plate is firmly riveted to the body.

If the operator attaches his identification, it must be ensured that the valve matches the application in question.

Example of name plate with CE marking:

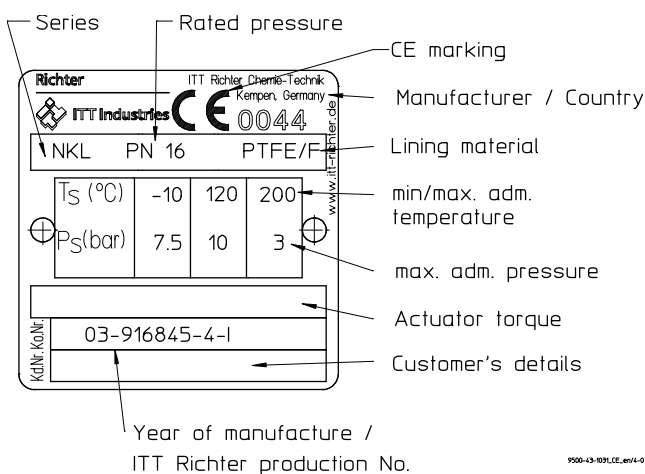

Body identification :

The following are visible on the body according to DIN EN 19 and AD 2000 A4:

- ◆ Nominal size
- ◆ Rated pressure
- ◆ Body material
- ◆ Manufacturer's identification
- ◆ Melt number/Foundry identification
- ◆ Cast date

1.3 Tightening torques

All screws greased, tighten in diametrically opposite sequence!

After the plant has been started up (especially with the first temperature load) the tightening torques must be checked and the correct value set again.

The tightening torques for pipe screws and body screws mentioned must not be exceeded. For an exception, see **Section 8**, flange connection valve/pipe is leaking.

The following tightening torques are recommended:

Packing screws

Screws [ISO/DIN]	Tightening torque	
	[Nm]	[in-lbs]
2 x M8	3	27

Pipe screws, flanges to ISO/DIN

Flange nom. size [mm]	Screws [ISO/DIN]	Tightening torque	
		[Nm]	[in-lbs]
50	4 x M16	30	
80	8 x M16	25	
100	8 x M16	30	
150	8 x M20	55	
200	8 x M20	75	
250	12 x M20	65	
300	12 x M20	75	
350	16 x M20	75	
400	16 x M24	85	

Pipe screws flanges ISO/DIN drilled to ASME Class 150

Flange nom. size		Screws [ASME]	Tightening torque	
[mm]	[inch]		[Nm]	[in-lbs]
50	2"	4 x 5/8"	30	266
80	3"	8 x 5/8"	25	221
100	4"	8 x 5/8"	30	266
150	6"	8 x 3/4"	55	487
200	8"	8 x 3/4"	75	664
250	10"	12 x 7/8"	65	575
300	12"	12 x 7/8"	75	664
350	14"	12 x 1"	75	664
400	16"	16 x 1"	85	752

Body screws

Hex. Nut 920/2 for lug-style body

Nom. size		Hex. nuts [ISO/DIN]	Tightening torque	
[mm]	[inch]		[mm]	[inch]
50	2"	4 x M10	30	266
80	3"	4x M12	50	442
100	4"	4 x M12	50	442
150	6"	4 x M16	100	885
200	8"	4x M16	100	885
250	10"	4 x M16	100	885
300	12"	4 x M20	200	1770
350	14"	8 x M16	100	885
400	16"	8 x M20	200	1170


Hex. socket screw 914/1 for sandwich body

Nom. size		Hex. socket screw [ISO/DIN]	Tightening torque	
[mm]	[inch]		[mm]	[inch]
50	2"	2 x M10	30	266
80	3"	2 x M12	50	442
100	4"	2 x M12	50	442
150	6"	2 x M16	100	885
200	8"	2 x M16	100	885
250	10"	2 x M16	100	885
300	12"	2 x M20	200	1770
350	14"	4 x M16	100	885
400	16"	4 x M16	100	885

Hex. socket screw 914/1 for double-flange body

Nom. size		Hex. socket screw [ISO/DIN]	Tightening torque	
[mm]	[inch]		[mm]	[inch]
50	2"	2 x M10	30	266
80	3"	2 x M10	30	266
100	4"	2 x M10	30	266
150	6"	2 x M12	50	442
200	8"	2 x M12	50	442
250	10"	2 x M12	50	442
300	12"	2 x M12	50	442

1.4 Dimensions

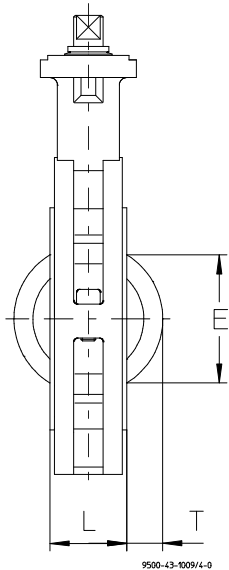

Nom. size		E ¹	T ¹	L ²	Connection ³
[mm]	[inch]	[mm]	[mm]	[mm]	
50	2"	28	4	43	F07
80	3"	67	17,5	46	F07
100	4"	87	24,5	52	F07
150	6"	142	48	56	F10
200	8"	193	71	60	F10
250	10"	243	92	68	F12
300	12"	292	112	78	F12
350	14"	343	137	78	F14
400	16"	389	150	102	F14

- 1 See also [Section 6.4, paragraph 1](#)
- 2 Face to face to DIN EN 558-1, series 20 (ISO 5752, series 20)
- 3 Connections for worm gears and brackets as per DIN ISO 5211

The inside diameter of the mounted pipe flanges must always be greater than the dimension E in the table! For more dimensions, see drawings in [Section 10](#).

1.5 Flow rate value k_v [m³/h]


Nom. size		Angel of opening							
[mm]	[inch]	20°	30°	40°	50°	60°	70°	80°	90°
50	2"	1	6	13	24	41	67	104	120
80	3"	5	22	47	82	126	197	264	282
100	4"	11	27	52	93	155	247	412	456
150	6"	37	84	164	276	431	702	1126	1254
200	8"	62	170	354	532	912	1371	2212	2503
250	10"	85	285	512	882	1451	2256	3692	4083
300	12"	159	421	835	1378	2282	3633	5735	6512
350	14"	230	610	1210	2000	3300	5270	8320	9450
400	16"	295	780	1550	2560	4240	6750	10650	12100

1.6 Weights (ca. kg)

Nom. size		Lug-style-body	Sandwich-body	Double-flange-body		
[mm]	[inch]	open shaft-end	open shaft-end	open shaft-end	Lever	Gear
50	2"	4,5	3,5	4,0	0,7	4,0
80	3"	7,5	4,5	5,0	0,7	4,0
100	4"	9,5	6,0	7,5	0,7	4,0
150	6"	16,0	11,0	12,0	3,7	4,5
200	8"	23,0	15,0	19,5	3,7	4,5
250	10"	35,0	25,0	29,0	–	9,5
300	12"	54,0	33,0	47,5	–	9,5
350	14"	68,0	47,0	–	–	15,0
400	16"	97,0	69,0	–	–	15,0

Actuator see data of the manufacturer

1.7 Pressure-temperature-diagram

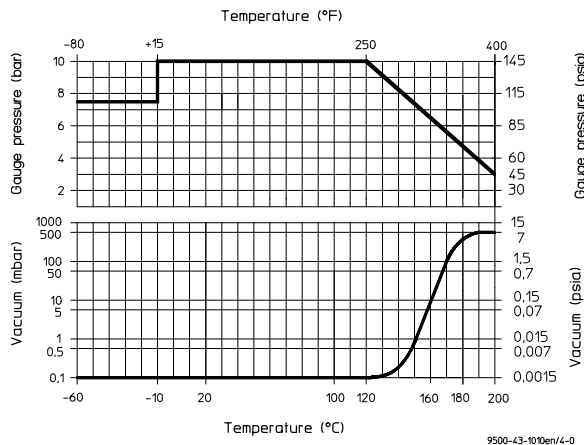

When used in the minus temperature range, the regulations applicable in the country in question must be observed.

A special material is used for the disc PFA lined for operating limits under -10 °C to -60 °C .

1.8 Breakaway torques

Nom. size		$M_{d_{erf}}$	$M_{d_{max}}$
[mm]	[inch]	[Nm]	[Nm]
50	2"	20	100
80	3"	46	180
100	4"	63	360
150	6"	128	725
200	8"	185	775
250	10"	287	1435
300	12"	410	1775
350	14"	550	3000
400	16"	650	3500

1.9 Cavitation coefficient z for 75% duty

Nom. size		z
[mm]	[inch]	(at $k_V/k_{VS} = 75\%$)
50	2"	0,32
80	3"	0,30
100	4"	0,29
150	6"	0,26
200	8"	0,23
250	10"	0,19
300	12"	0,16
350	14"	0,14
400	16"	0,12

2 Notes of safety

This operating manual contains fundamental information which is to be observed during installation, operation and maintenance. It must therefore be read before installation and commissioning.

For valves which are used in potentially explosive areas, see **Section 3**.

Installation and operation are to be performed by qualified staff.

The area of responsibility, authority and supervision of the staff must be regulated by the customer.



General hazard symbol!
 People may be put at risk.



Safety symbol! The ball valve and its function may be put at risk if this safety symbol is not observed.

It is imperative to observe warnings and signs attached directly to the ball valve and they are to be kept fully legible.

Non-observance of the notes on safety may result in the loss of any and all claims for damages.

For example, non-observance may involve the following hazards:

- ♦ Failure of important functions of the valve/plant.
- ♦ Risk to people from electric, mechanical and chemical effects.
- ♦ Risk to the environment through leaks of hazardous substances.

2.1 Intended use

Richter shut-off and control butterfly valves are pressure-maintaining components in accordance with the German Pressure Equipment Directive (DGRL) for the passage and shut-off of fluids. The valves are suitable for vapours, gases and liquids of group 1 according to the DGRL and have a corrosion-resistant plastic lining.

The field of application for the shut-off and control butterfly valves include:

- Light and medium corrosive, pure and slightly solids-laden liquids, vapours and gases
- Materials in contact with the medium which are FDA-compliant can be used for food and pharmaceutical feedstock as well as in biochemistry.
- Powdered and granulated non or low abrasive solids

Shut-off and control butterfly valves with a plastic-lined disc/stem unit are used for highly aggressive, corrosive media.

Shut-off and control butterfly valves with a stainless steel disc/stem unit are suitable for less aggressive media, are cheaper and beneficial for thorough valve cleaning.

With all 3 body versions the valves can be installed as a sandwich-type valve (intermediate flange valve), with lug-style and double-flange body as a flange or dead-end valve.

Product features:

- Wide sealing surfaces of the body lining
- Long valve neck for optimum heat insulation
- Maintenance-free, self-adjusting stem seal
- Leak-proof to the atmosphere in accordance with the German Clean Air Code

Solids can lead to increased wear, leaks, damage to sealing surfaces or to a reduction in the service life of the valve.

In case of the valve is intended for operating data other than those intended, the customer must carefully examine whether the design of the valve, accessories and materials are suitable for the new application (consult the manufacturer).

2.2 For the customer / operator

When using the valve, it must be ensured that

- ♦ actuators which are retrofitted are adapted to suit the valve
- ♦ hot or cold valve parts are protected by the customer against being touched
- ♦ the valve has been properly installed in the pipe system
- ♦ the usual flow rates are not exceeded in continuous operation.

This is not the manufacturer's responsibility.

Fire protection to DIN EN ISO 10497 is not possible (plastic lining and plastic components).

2.3 Inadmissible modes of operation

The operational reliability of the valve supplied is only guaranteed if it is used properly in accordance with **Section 2.1** of this operating manual.



The operation limits specified on the identification plate and in the pressure-temperature diagram must under no circumstances be exceeded.

3 Safety notes for applications in potentially explosive areas based on the Directive 94/9/ EC (Atex 95)

The valves are intended for use in a potentially explosive area and are therefore subject to the conformity assessment procedure of the directive 94/9/EC (ATEX).

As part of this conformity assessment, an ignition hazard analysis to EN 13463-1 to satisfy the fundamental safety and health requirements was conducted with the following result:

- ♦ **The valves do not have any ignition source of their own and can be operated both manually as well as mechanically/electrically.**

- ♦ **The valves are not covered by the scope of application of the ATEX directive and therefore do not need to be identified accordingly.**
- ♦ **The valves may be used in a potentially explosive area.**

Supplementary notes:

- ♦ **Electric/mechanical actuators must be subjected to their own conformity assessment to ATEX.**

It is imperative to observe the individual points of intended use for application in a potentially explosive area.

3.1 Intended use

Inadmissible modes of operation, even for brief periods, may result in serious damage to the unit. In connection with explosion protection, potential sources of ignition (overheating, electrostatic and induced charges, mechanical and electric sparks) may result from these inadmissible modes of operation; their occurrence can only be prevented by adhering to the intended use.

Furthermore, reference is made in this connection to the Directive 95/C332/06 (ATEX 118a) which contains the minimum regulations for improving the occupational health and safety of the workers who may be at risk from an explosive atmosphere.

A difference is made between two cases for the use of chargeable liquids (conductivity $< 10^{-8}$ S/m):

1. Chargeable liquid and non-conductive lining

Charges can occur on the lining surface. As a result, this can produce discharges inside the valve. However, these discharges cannot cause ignitions if the valve is completely filled with medium.

If the valve is not completely filled with medium, e.g. during evacuation and filling, the formation of an explosive atmosphere must be prevented, e.g. by superimposing a layer of nitrogen.

It is recommended to wait 1 hour before removing the valve from the plant in order to permit the elimination of static peak charges.

This means that, to safely prevent ignitions, the valve must be completely filled with medium at all times or else a potentially explosive atmosphere must be excluded by superimposing a layer of inert gas.

2. Chargeable liquid and conductive lining

No hazardous charges can occur as charges are discharged direct via the lining and shell (surface resistance $< 10^9$ Ohm, leakage resistance $< 10^6$ Ohm).

Static discharges of non-conductive linings are only produced through the interaction with a non-conductive medium and are therefore the responsibility of the plant operator.

Static discharges are not sources of ignition which stem from the valves themselves!

- The temperature of the medium must not exceed the temperature of the corresponding temperature class or the maximum admissible medium temperature as per the operating manual.
- If the valve is heated (e.g. heating jacket), it must be ensured that the temperature classes prescribed in the Annex are observed.
- To achieve safe and reliable operation, it must be ensured in inspections at regular intervals that the unit is properly serviced and kept in technically perfect order.
- Increased wear to the valve can be expected with the conveyance of liquids containing abrasive constituents. The inspection intervals are to be reduced compared with the usual times.
- Actuators and electric peripherals, such as temperature, pressure and flow sensors etc., must comply with the valid safety requirements and explosion protection provisions.
- The valve must be grounded.
This can be achieved in the simplest way via the pipe screws using tooth lock washers. Otherwise grounding must be ensured by other action, e.g. cable bridges.
- Attachments such as actuators, position controllers, limit switches etc. must satisfy the relevant safety regulations as regards explosion protection and, if required, be designed in compliance with ATEX.
- Special attention must be paid to the appropriate safety and explosion protection notes in the respective operating manuals.
- Plastic-lined valves must not be operated with carbon disulphide.

4 Safety note for valves, certified to Clean Air Act (TA-Luft)

Certificate / Manufacturer Declaration Validity is dependent on the operating instructions being read and observed.

In particular, servicing must be conducted at regular intervals, and the bolted connections relevant for tightness must be inspected and retightened if necessary.

5 Transport and storage



It is imperative, for all transport work, to observe generally accepted engineering practice and the accident prevention regulations.



The valve is supplied with flange caps. Do not remove them until just before installation. They protect the plastic surfaces against dirt and mechanical damage.

Handle the goods being transported with care. During transport the valve must be protected against impacts and collisions.

Directly after receipt of the goods, the consignment must be checked for completeness and any in-transit damage.

Do not damage paint protection.

5.1 Storage

If the valve is not installed immediately after delivery, it must be put into proper storage.

It should be stored in a dry, vibration-free and well-ventilated room at as constant a temperature as possible.

It is not permitted to put the valve into store with the disc completely closed or with an opening angle greater than 15°.

5.2 Transport preparations

During transport the disc/stem unit must not project beyond the body dimensions.

Hand lever:

When the valve is in the closed position, the lever is to lock in the first lever catch. This results in the disc/stem unit being slightly opened.

Worm gear

When the valve is in the closed position, the disc/stem unit is to be 10-15° open.

Actuator

When the valve is in the closed position, the disc/stem unit is to be 10-15° open.

Attach a locking plate on shut-off and control butterfly valves with a single-acting actuator. See also **Section 6.4.1** and the drawing in **Section 5.4**.

Mount flange caps.

5.3 Return consignments




Valves which have conveyed aggressive or toxic media must be well rinsed and cleaned before being returned to the manufacturer's works.

A **General Safety Certificate** on the field of application is to be enclosed with the returned goods.

Pre-printed forms are enclosed with the installation and operating manual.


Safety precautions and decontamination measures are to be mentioned.

5.4 Transport securing device

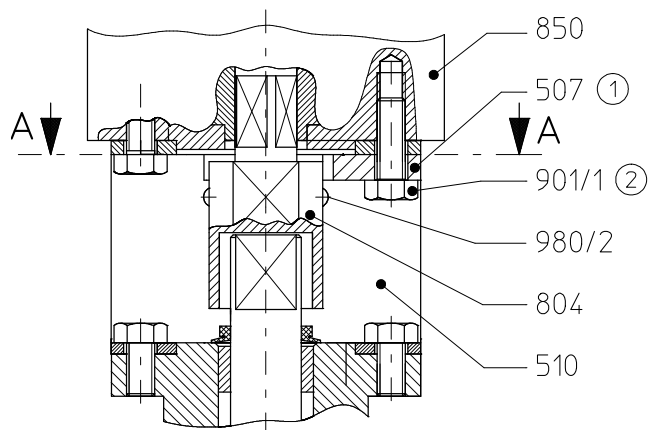

- ① Only with single acting actuator. Remove it at installation. See also **Section 6.4.1**.
- ② Screw in again the hex. nuts after removing the locking plate.

A-A

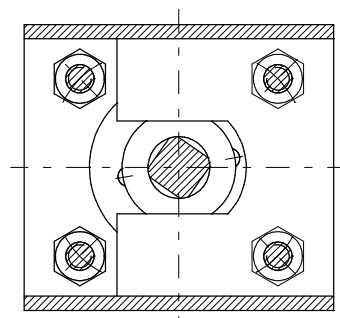

9500-43-1137_en/4-0

Drawing is also valid for NKL, NKS und NK with a commercial worm gear.

6 Installation

Examine valve for in-transit damage, damaged ball valves must not be installed.

Before installation the valve and the connecting pipe must be carefully cleaned to remove any dirt, especially hard foreign matter.

During installation, pay attention to the correct tightening torque, aligned pipes and tension-free assembly.

6.1 Installation possibilities

Series NK double-flange body

They can be connected for sandwich installation or as dead-end valves. They have flange bores to ISO 7005-2 PN 10 (DIN 2501 PN 10) or to ASME/ANSI B 16.5 Class 150.

When installed as intermediate flange valves, the pipe screws are inserted through the flange bores and serve as a centering aid.

When installed as a dead-end valve, threaded rods and nuts are used, thus providing an alternative connection to either pipe side.

Series NKS sandwich body

They are used for sandwich installation. The valve is clamped between the two pipes.

Series NKL lug-style body

They are suitable as an intermediate flange and dead-end valve. They have flange bores to ISO 7005-2 PN 10 (DIN 2501 PN 10) to ASME/ANSI B 16.5 Class 150; they permit independent bolting from each other. On request, through holes can also be provided instead of the tapped bores.

6.2 Flange caps and gaskets

Leave protective caps on the flanges until just prior to installation.

Where there is a particularly high risk of damage to the plastic sealing surfaces, e.g. if the mating flanges are made of metal or enamel, PTFE-lined gaskets with a metal inlay should be used. These gaskets are available as special accessories in the ITT Richter range.

6.3 Direction of flow and installation position

Installation is independent of the direction of flow.

Any fitting position can be chosen.

Except solids-containing liquids:

In order to avoid adhering residue in the area of the disc bearing, the stem should lie horizontally.

Solids can best be flushed away when the bottom half of the disc opens into flow direction.

6.4 Installation

- Can the disc open in the pipeline?
- For dimensions see **Section 1.4**.
- Is the disc open 10 – 15°?
- Mount butterfly valve and gaskets.
- Tighten the piping bolts crosswise and hand-tight.
- By means of a test actuation ensure that the disc is able to freely rotate.
- With the disc slightly opened, tighten the piping bolts crosswise. For the torques see **Section 1.3**.
- If a shut-off or butterfly valve is installed as a dead-end valve, it must be ensured that it is closed with a blind flange and the valve is secured against being opened unintentionally.

6.4.1 Additional advice for shut-off and control butterfly valve with actuator



For single-acting actuators a locking plate has been fitted into the bracket, blocking the stem at a disc opening of 10 – 15°.

Remove the locking plate before the first test actuation, screw in again hex. screw **901/1**. Slightly actuate the actuator.

Please pay attention to the drawing in **Section 5.4**.

6.5 Earthing

One end of the grounding rope **532** is attached with a hex. nut **920/1** and a tooth lock washer **936/1** to the underside of the head flange.

The other end is metallically secured in the plant.

Series NK, NKP

Butterfly valves with tapped bores are earthed by the pipe screws.

7 Operation

7.1 Initial commissioning

Normally, the ball valves have been tested for leaks with air or water.

Unless otherwise agreed, there could be residual amounts of water in the flow section of the ball valve; this could result in a possible reaction with the medium.



To prevent leaks, all connection screws should be retightened after the initial loading of the valve with operating pressure and operating temperature.

For torques see [Section 1.3](#).

7.2 Inadmissible modes of operation and their consequences

- ◆ Do not operate the butterfly valve without valve actuation. Otherwise the disc will be uncontrollably set in motion by the medium flow.
- ◆ Butterfly valves with a hand lever should never be abruptly opened or closed. This can lead to water hammer effects.
- ◆ Dissipate thermal expansion volumes in shut-off pipes.
- ◆ If the plastic swells up due to the effect of the medium, this can result in the functional parts jamming.
- ◆ Operation with solids leads to increased wear.

- ◆ Operation during cavitation leads to increased wear.
- ◆ Non-observance of the pressure-temperature diagram can lead to damage of the plastic lining.
- ◆ There must be no foreign matter on the sealing surfaces.

7.3 Shutdown

Before loosening the flange bolts:



- ◆ ensure plant to be free of pressure
- ◆ flush out medium
- ◆ observe safety regulations

Prior to starting any repair work, the valve is to be thoroughly cleaned. Even if the valve has been properly emptied and rinsed, residual medium may still be found in the valve,

After dismantling, immediately protect the valve flanges against mechanical damage with flange caps. See also [Section 6.2](#).

7.3.1 Additional advice for shut-off and control butterfly valve with actuator

Ensure that a remotely actuated quarter-turn actuator cannot be accidentally switched on.

Having dismantled the valve, mount the locking plate **507** and screw in with hex. screw. **901/1**.

See [Section 6.4.1](#) and drawing in [Section 5.4](#).

8 Malfunctions

- ◆ Flange connection ball valve/pipe is leaking
Retighten the flange screws to a tightening torque according to [Section 1.3](#). If this does not remedy the leak, the recommended torques may be exceeded by 10%.
If this also fails to stop the leak, dismantle and inspect the ball valve.
Dismount and inspect the valve.
- ◆ Stem passage leaking
With no safety stuffing box:
Dismount valve and repair.
With safety stuffing box:
First of all, the packing gland follower can be tightened.
For torques see [Section 1.3](#).
Then dismantle the valve as quickly as possible and repair.
- ◆ Medium leaking at the partition between lower and upper halves
Dismount valve and repair, probably the stem seal is not tight.
- ◆ Valve does not switch
Has the locking plate been dismantled?
See [Section 5.4](#).
Is the actuator supplied with power?
Has a directional control valve been correctly connected?
Is there foreign matter in the valve?
- ◆ The bore of the valve is leaking
Wear at the valve actuation ?
Do limit stops have to be adjusted?
Is the shaft deformed?
Deformation, damage or wear to body lining or disc?

9 Maintenance

Spare parts are to be ordered with all the details in acc. with the valve identification.

Only original spare parts may be installed.

To prevent leaks, a regular check of the connection screws should be made in line with the operating requirements. For torques see **Section 1.3**.

When disassembling and assembling the valve, attention is to be paid to the tables and drawings in **Section 1 and 10**.

As the body lining **409** is drawn over the disc/stem unit **221** while warm, this work should only be carried out by the manufacturer.

Has the pump been shut down, drained and flushed according to the regulations?

See also **Section 7.3**.



If assembled incorrectly, individual components of the valve may be damaged and this can result in malfunctions during operation.

9.1 Notes for assembly

- The flexible inlay **521** expands during assembly. Do not cut off the overhang, but push back into the lower and upper part of the shell **120**.
- Before tightening the body screws **914/1** (on NKL/NKLP threaded rod **918/1** and hex. nut **920/2**), align the disc/stem unit **221** centrally in the closed position.
- Mark the position of the disc/stem unit **221** against body lining **409** at the hub, so permitting switching only to this point during later test switching.
- With disc/stem unit in closed position, tighten the body screws (**914/1**, as well **918/1** and **929/2**) until the gap between the upper and lower part of the shell **120** is ca. 5 mm.
- Open the valve several times **counterclockwise** (when viewing the stem unit) and close again in the opposite direction. A sealing edge can form in this way.

Never switch in the other direction of rotation over the sealing edge!

- Tighten the body bolts 1-2 mm when disc in closed position.
- Repeat the previously described process once or twice.
- When finally tightening the body bolts, pay attention to the torques provided in **Section 1.3**.

9.1.1 Safety stuffing box:

- Insert sealing foil **413** between the upper and lower half of the shell **120**.
- Displace packing rings **402/1** by 90° against each other
- Tighten stuffing box bolts **901/3** with torque in accordance with **Section 1.3**.

For detailed installation and inspection regulations for shut-off and control butterfly valves, see QM No. 0910-08-1005, available from ITT Richter on request.

9.2 Valve actuation

The valve stem has a pivot to attach a hand lever respectively a coupling.

Hand lever respectively pivot parallel to the axis of the pipeline: → Valve open

Hand lever respectively pivot at right angles to the axis of the pipeline: → Valve closed

In the case of a coupling, 2 red marks indicate the position of the disc on them.

Marks parallel to the axis of the pipeline:

→ Valve open

Marks at right angles to the axis of the pipeline:

→ Valve closed

9.2.1 Actuated with lever

The throttling plate **519** permits a fixing of the lever at 15° intervals. It is lockable with a commercially available padlock.

9.2.2 Actuated by means of worm gear

In the standard version, the manufacturer normally provides worm gears with a special pick-up for the stem pivot.

The bracket and the coupling are thereby not required.

Commercially available worm gears equipped with a connection as per ISO 5211 can also be connected. These require a bracket and a coupling however.

This version is also necessary for butterfly valves with a safety stuffing box.

Couplings and brackets are available as accessories in the Richter range of products.

9.2.3 Remotely actuated

Richter butterfly valves can be remotely actuated by means of pneumatic, hydraulic or electric quarter-turn actuators equipped with a connection as per ISO 5211.

Couplings and brackets are available as accessories in the Richter range of products.

9.2.4 Required breakaway torque



The breakaway torque of the actuator must be at least as high as the breakaway torque of the butterfly valve, about 20% higher being better however.

Media of higher viscosity and/or those with solids may require an increased factor of safety when calculating the size of the actuator. This is particularly true for non-Newtonian fluids such as high polymer substances, suspensions, pastes, lubricants, resins, lacquers etc.

Admissible factors of safety lie in the range of 20 - 50% of the breakaway torque.

To prevent damage to the valve, particular attention must be paid to the torque $M_{d_{max}}$ in [Section 1.8](#).

9.3 Options

9.3.1 Safety stuffing box

The safety stuffing box acts independently from the standard shaft gasket and can be re-adjusted by hand.

Only with the option safety stuffing box: A sealing foil **413** is inserted between the upper section and the lower section of shell.

If the shaft gasket is damaged, the valve can thus continue to be operated for a short time.

See drawing [Section 10.2](#).

9.3.2 Monitoring connection

The monitoring connection, between the standard shaft gasket and the safety stuffing box, can be fitted with attachments for monitoring pressure.

It can indicate leaks or build up a protective nitrogen layer. See drawing [Section 10.2](#).

9.3.3 Proximity switch

The proximity switch reliably indicates the closed position of the valve disc. The signal penetrates the thick-walled lining.

9.4 Tests

Following tests would be done after the assembly.

Measurement of the breakaway torque

The breakaway torque required for opening and closing the valve is to be ascertained. The maximum torque should not exceed the values given in [Section 1.8](#).

Tightness of valve opening and shaft bushing

The completed valves have to undergo a „leak test of the closure with air“.

The tightness of the shaft bushing (stuffing box) of each valve is tested. The holding time begins once the residual air has escaped from the stuffing box chamber.

Tightness is verified according to DIN EN 12266-1 respectively MSS SP-67.


For detailed installation and inspection regulations for shut-off and control butterfly valves, see QM No. 0910-08-1005, available from ITT Richter on request.

10 Drawings

10.1 Legend


120	shell	517	scraper ring
221	disc/stem unit	518	cup spring assembly
229	guide pin (up to. DN 150 / 6" inclusive)	519	throttling plate
235	lever assembly	521	flexible inlay
300	plain bearing	532	grounding grope
400/1	o-ring	550	disc
402/1	packing ring	804	coupling
405	thrust ring	850	actuator
409	body lining	857	warm gear
412	pressure gasket	901/x	hex. screw
413	sealing foil	914/1	hex. socket screw
503	spring gland follower	918/1	threaded rod
507	support	920/x	hex. nut
510	bracket	936/1	toothed lock washer
		980/x	round head grooved pin

10.2 Safety stuffing box (Option)

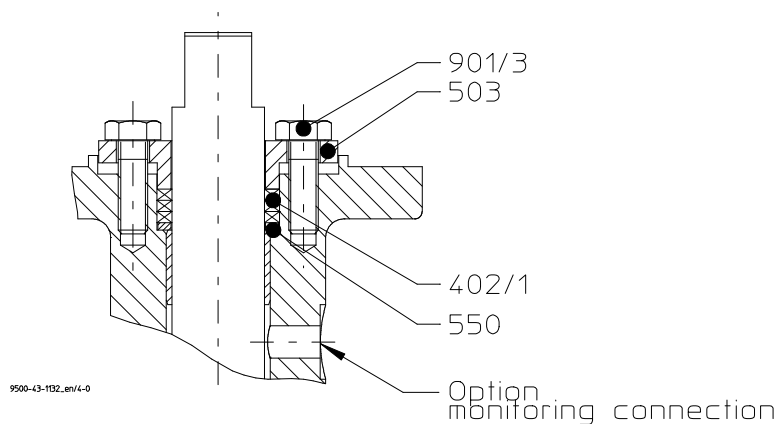

10.3 Sectional drawing NKL

Lug-style body with hand lever and PFA-lined disc/stem unit

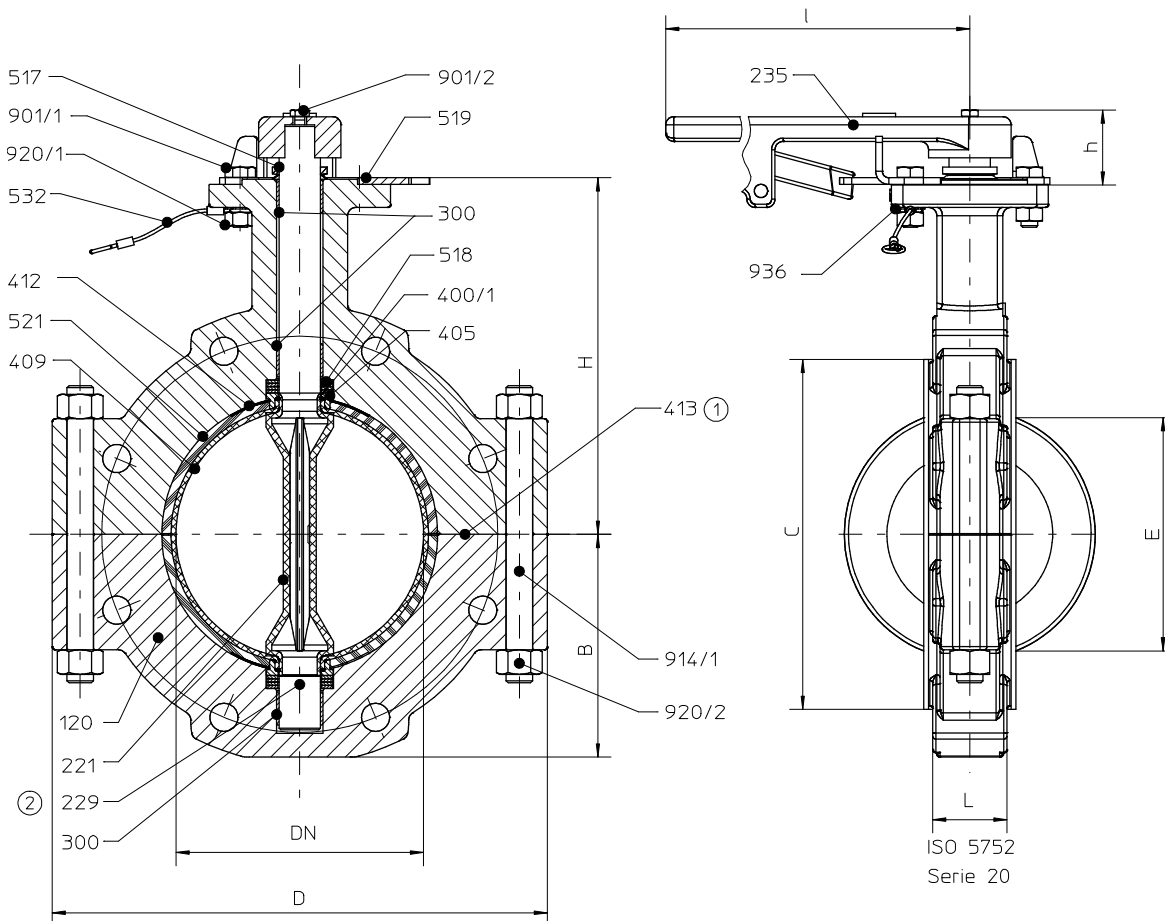

DN 250 to 400 only with worm gear or actuator
 See Section 10.7 und 10.8

DN	50	80	100	150	200	250	300	350	400
H	135	160	175	212	232	272	297	335	360
h	40	40	40	27	27	—	—	—	—
l	300	300	300	500	500	—	—	—	—
B	72	89	100	128	165	195	225	258	282
L	43	46	52	56	60	68	78	78	102
D	152	207	236	300	352	434	520	558	630
C	90	128	150	212	265	315	365	430	480
E	28	67	87	142	193	243	292	343	389

all dimensions in mm


① only option
 safety stuffing box

② only to incl. DN 150

9500-43-1136_en/4-0

10.4 Sectional drawing NKS

Sandwich-type body with hand lever and PFA-lined disc/stem unit

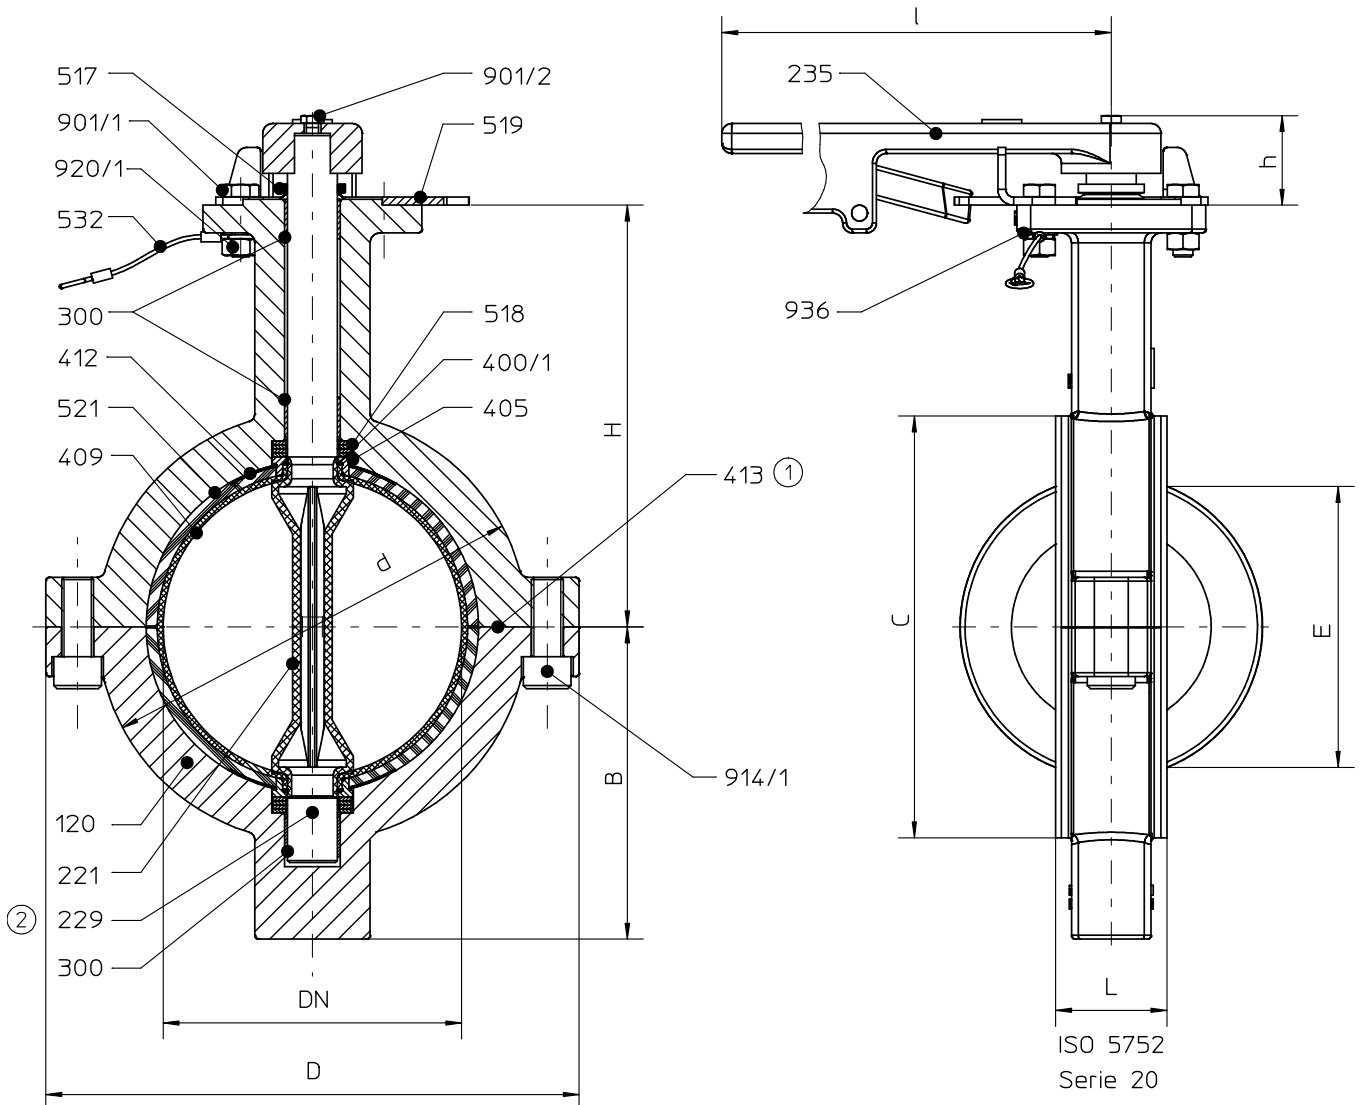

DN 250 to 400 only with worm gear or actuator
 See Section 10.7 and 10.8

DN	50	80	100	150	200	250	300	350	400
H	135	160	175	212	232	272	297	335	360
h	40	40	40	27	27	—	—	—	—
l	300	300	300	500	500	—	—	—	—
B	72	100	118	153	181	213	250	285	282
L	43	46	52	56	60	68	78	78	102
D	135	178	205	268	326	380	452	500	565
C	90	128	150	212	265	315	365	430	480
E	28	67	87	142	193	243	292	343	389
d	100	134	160	216	267	327	375	436	490

all dimensions in mm


① Only option
 safety stuffing box

② only to incl. DN 150

9500-43-1133_en/4-0

10.5 Schnittzeichnung NK

Double-flange body with hand lever and stainless steel disc/stem unit

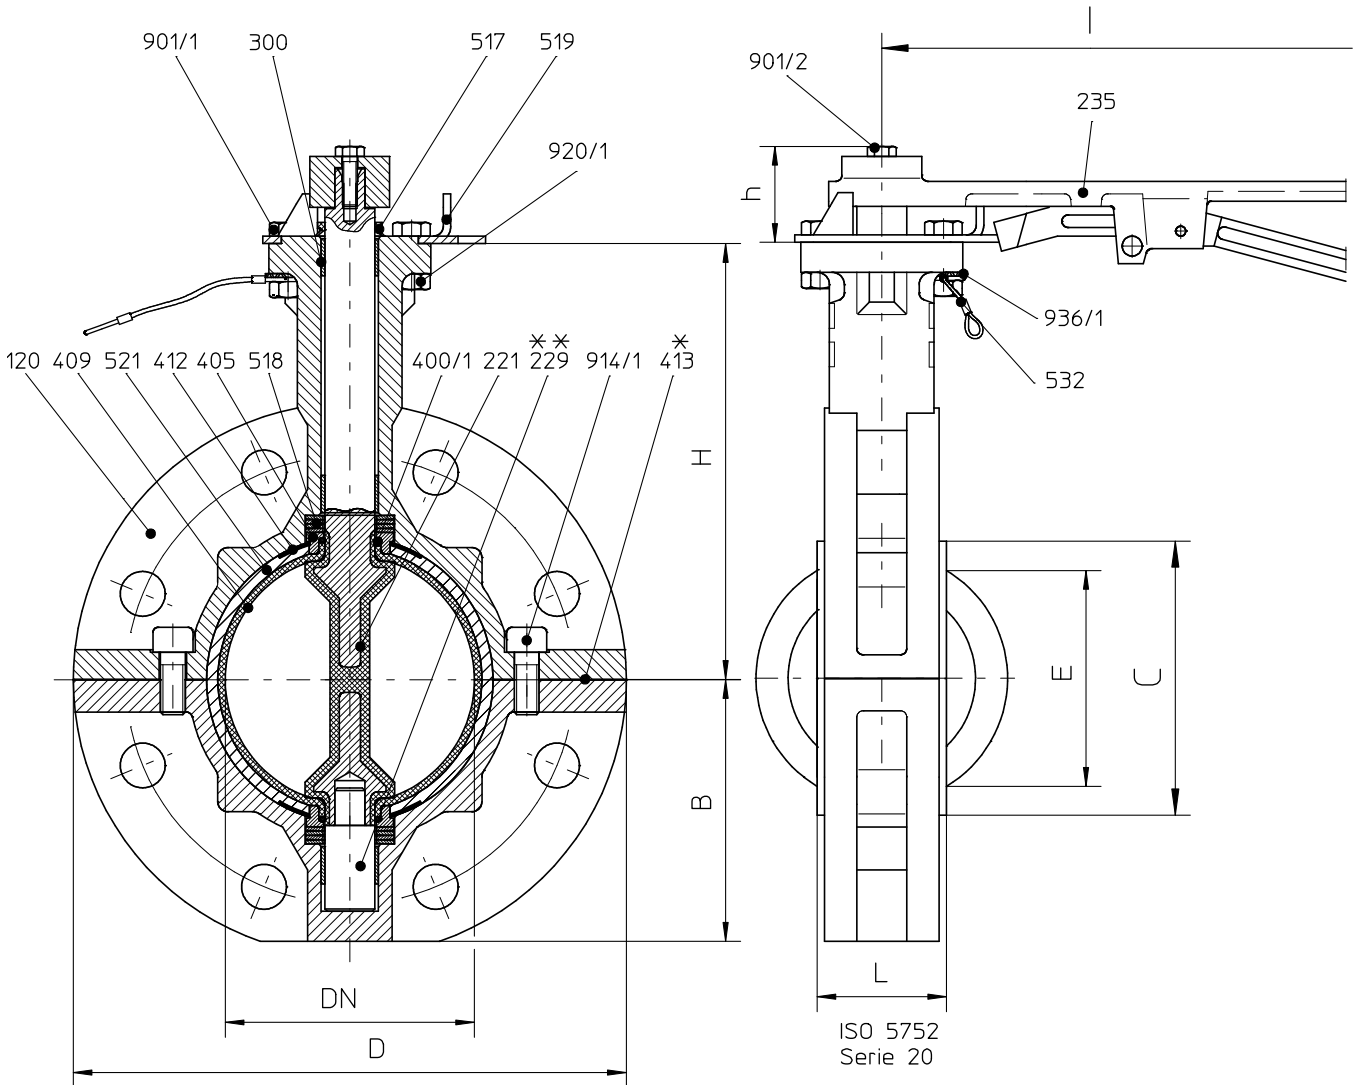

DN	50	80	100	150	200	250	300
H	135	160	175	212	232	272	297
h	40	40	40	48	48		
l	300	300	300	500	500		
B	66	93	106	135	165	195	230
L	43	46	52	56	60	68	78
D	165	200	222	285	340	405	470
C	90	128	150	212	265	315	365
E	28	67	87	142	193	243	292

* Only Option safety stuffing box


** up to DN150 inclusive

9500-43-1131_en/4-0

DN 250 and 300 only with wormgear or actuator operated
 see [Section 9.6](#) or [9.7](#)

all dimensions in mm

10.6 Connecting dimensions worm gear

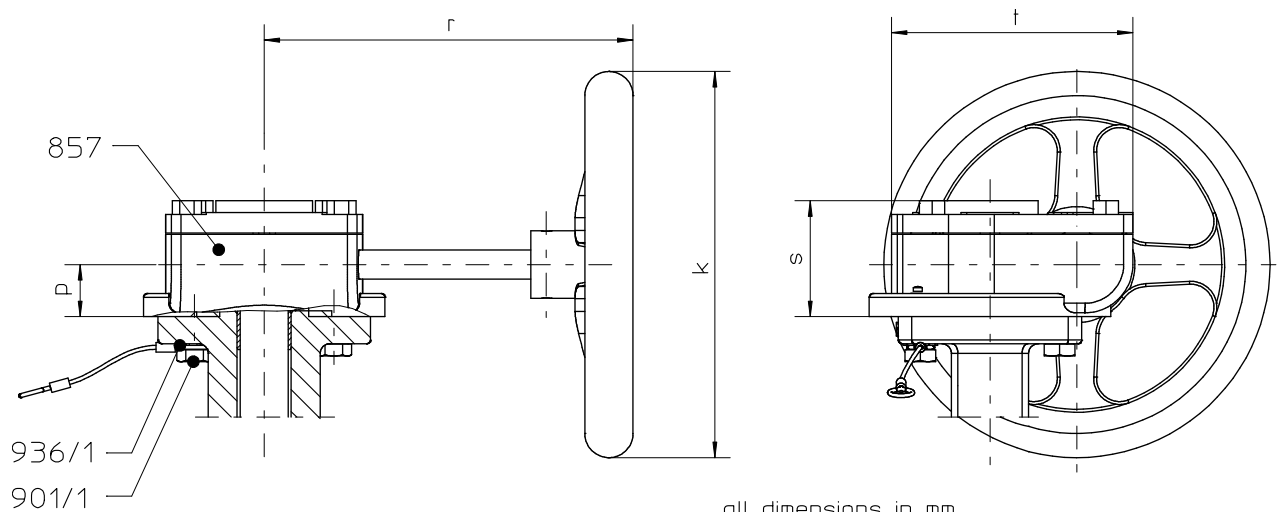


all dimensions in mm

DN	50	80	100	150	200	250	300	350	400
p	27	27	27	27	27	40	40	42	42
k	100	150	150	150	150	250	250	250	250
r	181	181	181	181	181	206	206	226	226
s	62	62	62	62	62	89	89	92	92
t	102	102	102	125	125	174	174	214	214

9500-43-1135_en/4-0

all dimensions in mm

10.7 Connecting dimensions actuator

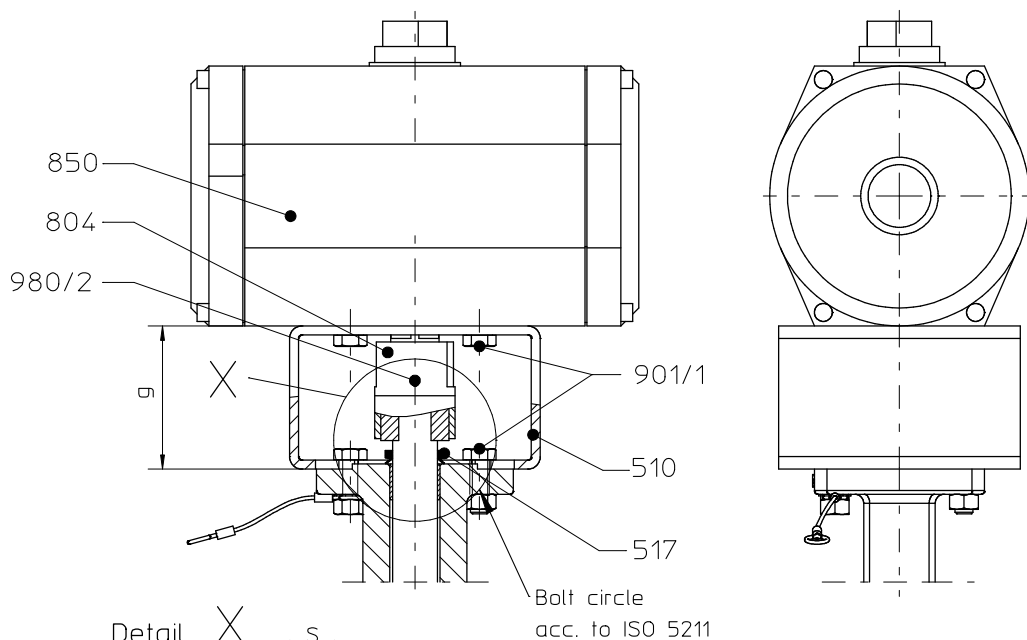

Bolt circle
acc. to ISO 5211

9500-43-1134_en/4-0

all dimensions in mm

DN	50	80	100	150	200	250	300	350	400
g	60	60	60	80	80	80	80	100	100
A	30	30	30	36	36	42	43	50	50
M	15	15	16	20	20	25	25	35	35
SW	10	11	12	18	18	22	22	25	30
∅S	14	16	20	25	25	30	32	35	40

all dimensions in mm

Safety Information / **Declaration of No Objection** Concerning the Contamination of Richter-Pumps, -Valves and Components

1 SCOPE AND PURPOSE

Each entrepreneur (operator) carries the responsibility for the health and safety of his employees. This extends also to the personnel, who implements repairs with the operator or with the contractor.

Enclosed declaration is for the information of the contractor concerning the possible contamination of the pumps, valves and component sent in for repair. On the basis of this information for the contractor is it possible to meet the necessary preventive action during the execution of the repair.

Note: The same regulations apply to repairs **on-site**.

2 PREPARATION OF DISPATCH

Before the dispatch of the aggregates the operator must fill in the following declaration completely and attach it to the shipping documents. The shipping instructions indicated in the respective manual are to be considered, for example:

- Discharge of operational liquids
- remove filter inserts
- lock all openings hermetically
- proper packing
- Dispatch in suitable transport container
- Declaration of the contamination fixed **outside!!** on the packing

Declaration about the Contamination of Richter Pumps, -Valves and Components

The repair and/or maintenance of pumps, valves and components can only be implemented if a completely filled out declaration is available. If this is not the case, delay of the work will occur. If this declaration is not attached to the devices, which have to be repaired, the transmission can be rejected.

Every aggregate has to have it's own declaration.

This declaration may be filled out and signed only by authorized technical personnel of the operator.

Contractor/dep./institute : _____		Reason for transmitting <input checked="" type="checkbox"/> Please mark the applicable	
Street : _____		Repair: <input type="checkbox"/> subject to fee <input type="checkbox"/> Warranty	
Postcode, city: _____		Exchange: <input type="checkbox"/> subject to fee <input type="checkbox"/> Warranty	
Contact person: _____		<input type="checkbox"/> Exchange/ Replacement already initiated/received	
Phone : _____	Fax : _____	Return: <input type="checkbox"/> Leasing <input type="checkbox"/> Loan <input type="checkbox"/> for credit note	
End user : _____			
A. Details of Richter-product:		Failure description:	
Classification: _____		_____	
Article number: _____		Equipment: _____	
Serial number: _____		Application tool: _____	
_____		Application process: _____	
B. Condition of the Richter-product:		Contamination :	
	no ¹⁾ yes no		no ¹⁾ yes
Was it in operation ?	<input type="checkbox"/> <input type="checkbox"/> <input checked="" type="checkbox"/>	toxic	<input type="checkbox"/> <input type="checkbox"/>
Drained (product/operating supply item) ?	<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	caustic	<input type="checkbox"/> <input type="checkbox"/>
All openings hermetically locked!	<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	inflammable	<input type="checkbox"/> <input type="checkbox"/>
Cleaned ?	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	explosive ²⁾	<input type="checkbox"/> <input type="checkbox"/>
If yes, with which cleaning agent:		mikrobiological ²⁾	<input type="checkbox"/> <input type="checkbox"/>
and with which cleaning method:		radioactive ³⁾	<input type="checkbox"/> <input type="checkbox"/>
		other pollutant	<input type="checkbox"/> <input type="checkbox"/>
¹⁾ if "no", then forward to D. ← ²⁾ Aggregates, which are contaminated with microbiological or explosive substances, are only accepted with documented evidence of an approved cleaning. ³⁾ Aggregates, which are contaminated with radioactive substances, are not accepted in principle.		↓	
C. Details of the discharged materials (must be filled out imperatively)			
1. With which materials did the aggregate come into contact ? Trade name and/or chemical designation of operational funds and discharged materials, material properties, e.g. as per safety data sheet (e.g. toxic, inflammable, caustic)			
X	Trade name:	Chemical designation:	
a)	_____		
b)	_____		
c)	_____		
d)	_____		
2. Are the materials specified above harmful to health ?	no	yes	←
	<input type="checkbox"/>	<input type="checkbox"/>	
3. Dangerous decomposition products during thermal load ?	<input type="checkbox"/>	<input type="checkbox"/>	
If yes, which ones ? _____			

D. Mandatory declaration: We assure that the data in this explanation are truthful and complete and as a signatory I am able to form an opinion about this. We are aware that we are responsible towards the contractor for damages, which results from incomplete and incorrect data. We commit ourselves to exempt the contractor from claims for damages of thirds resulting from incomplete or incorrect data. We are aware that we are directly responsible towards thirds, irrespective of this declaration, which belongs in particularly to the employees of the contractor consigned with the handling repair of the product.

Name of the authorized person (in block letters): _____

_____ Date

_____ Signature

Company stamp

FAX

Fax No. ()

Pages (incl. cover sheet) ()

To:

()

Richter Chemie-Technik GmbH
Otto-Schott-Straße 2
D-47906 Kempen

Telefon +49 (0) 21 52/146-0
Telefax +49 (0) 21 52/146-190

richter-info@richter-ct.com
www.richter-ct.com

Contact person:
()

Reference:
()

Extension:
- ()

E-Mail Address:
()

Date:
()

Your order No.: ()

Our Kom. No.: ()

Serial No.: ()

Dear Sirs,

The compliance with laws for the industrial safety obligates all commercial enterprises to protect their employees and/or humans and environment against harmful effects while handling dangerous materials.

The laws are such as: the Health and Safety at Work Act (ArbStättV), the Ordinance on Harzadous Substances (GefStoffV, BIOSTOFFV), the procedures for the prevention of accidents as well as regulations to environmental protection, e.g. the Waste Management Law (AbfG) and the Water Resources Act (WHG)

An inspection/repair of Richter products and parts will only take place, if the attached explanation is filled out correctly and completely by authorized and qualified technical personnel and is available.

In principle, radioactively loaded devices sent in, are not accepted.

Despite careful draining and cleaning of the devices, safety precautions should be necessary however, the essential information must be given.

The enclosed declaration of no objection is part of the inspection/repair order. Even if this certificate is available, we reserve the right to reject the acceptance of this order for other reasons.

Best regards
RICHTER CHEMIE-TECHNIK GMBH

Enclosures

()